
Dual Loop Closed Chilling System

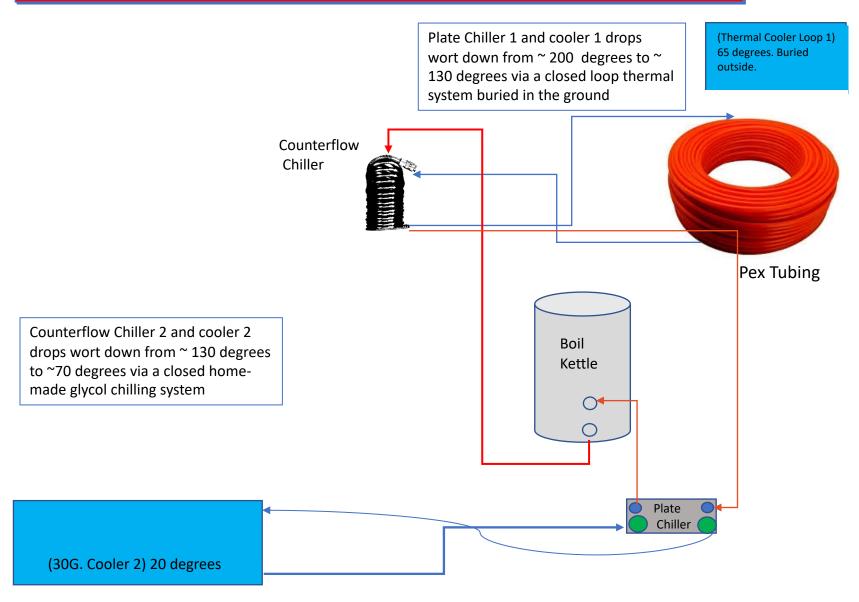

Note: Wort is in series with the chillers utilizing a closed recirculation method. Pumps are not illustrated.